
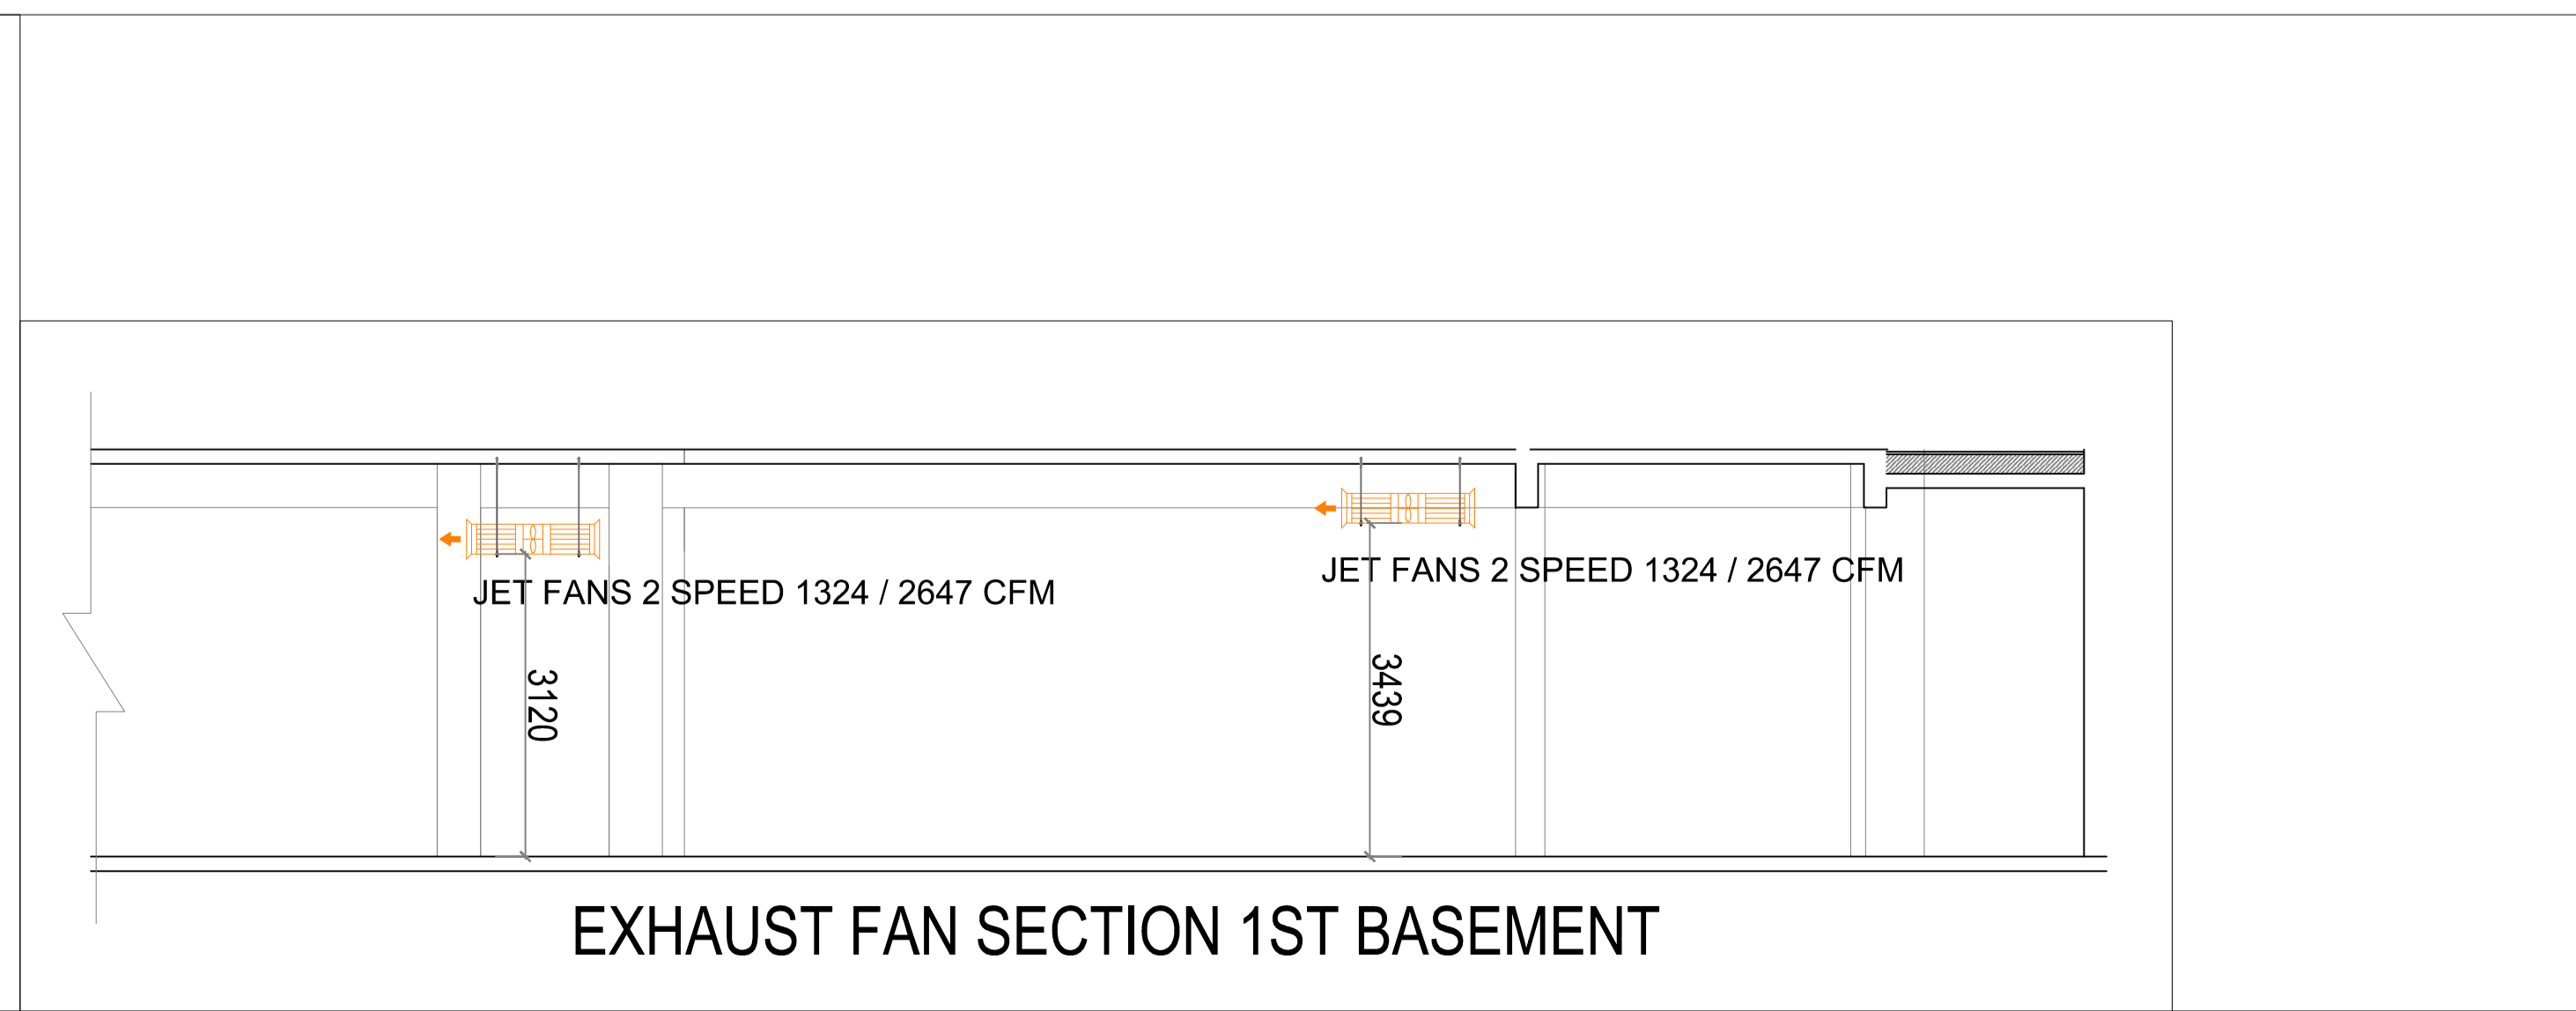
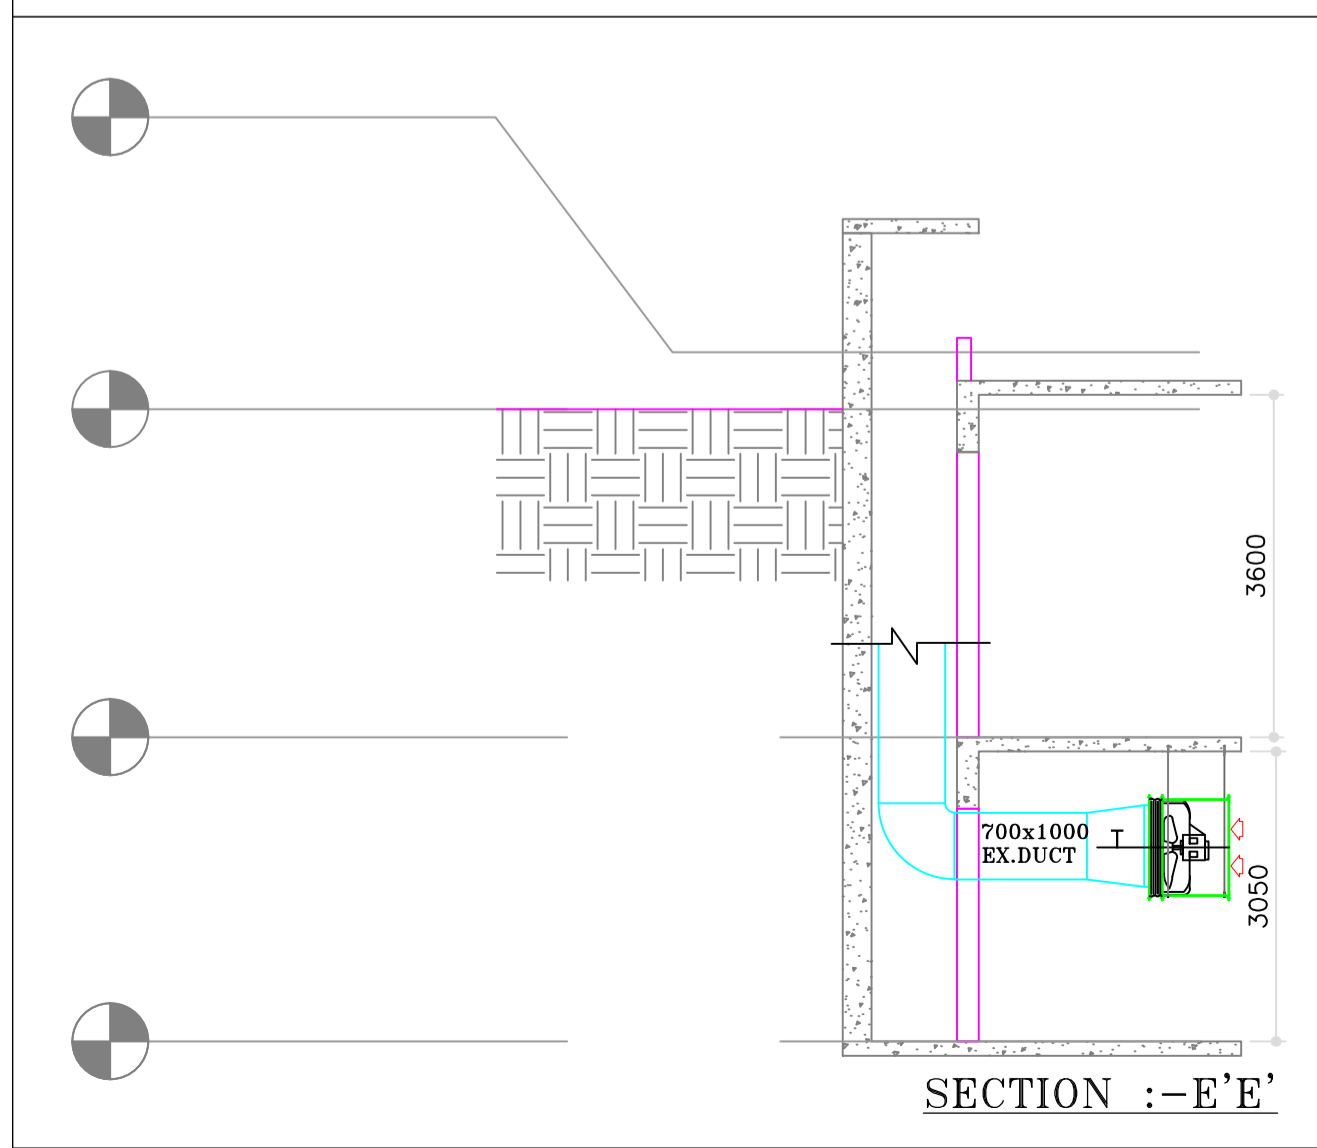
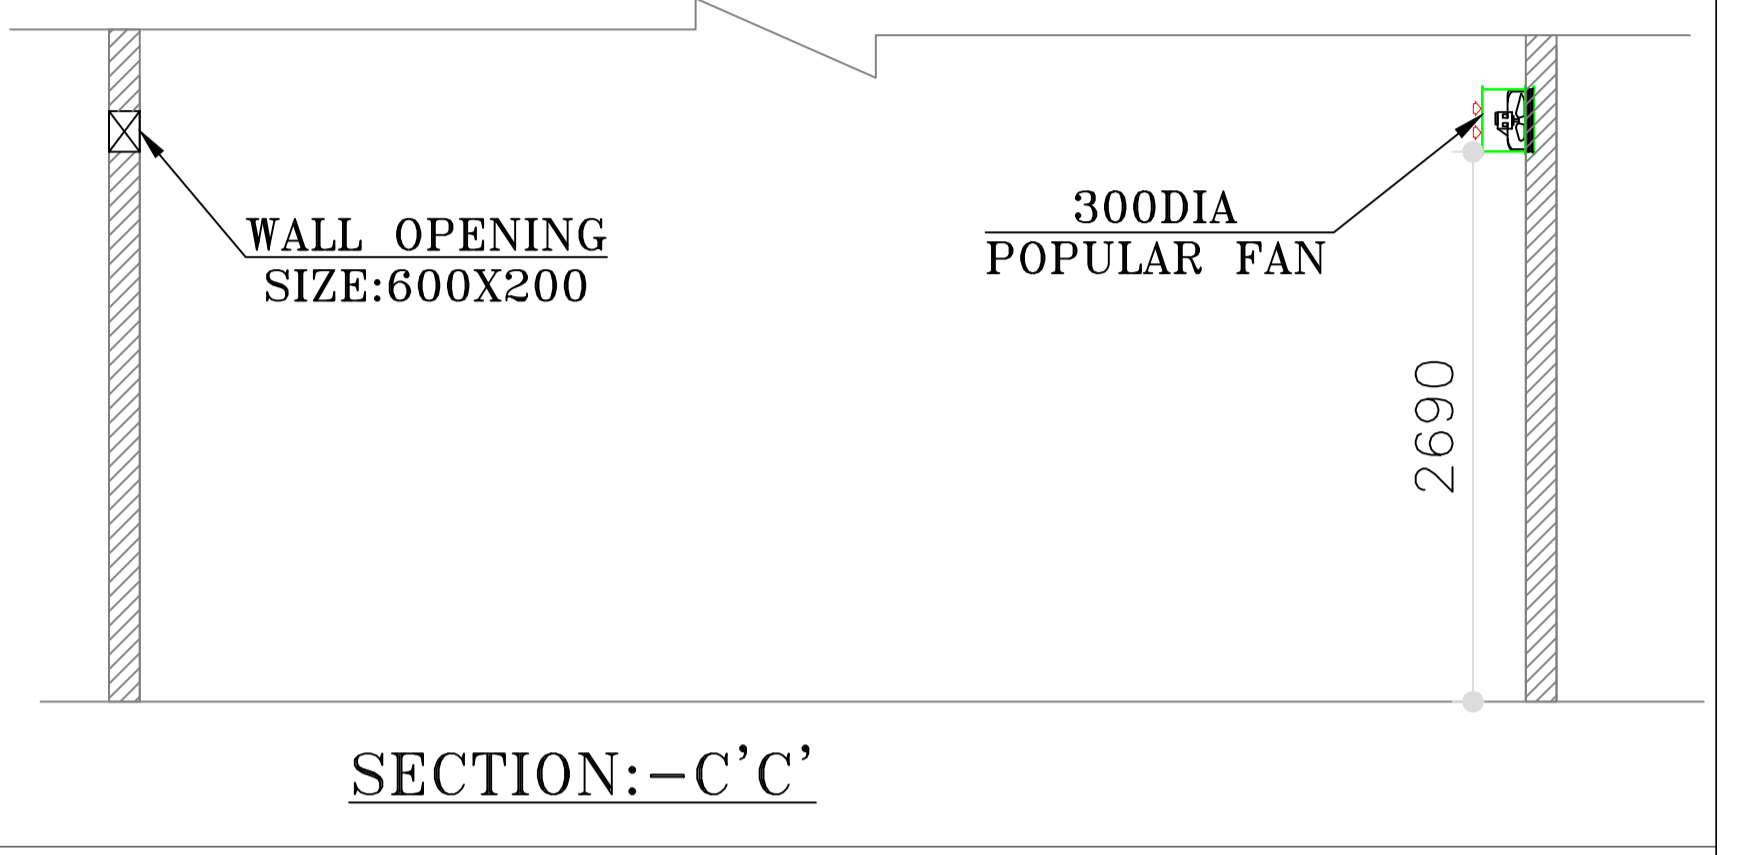


LEGENDS:-

SYMBOLS	DESCRIPTION
	FRESH AIR FAN
	EXHAUST FAN
	FRESH AIR DUCT
	EXHAUST AIR DUCT
	JET FAN
	FRESH AIR LOUVERS

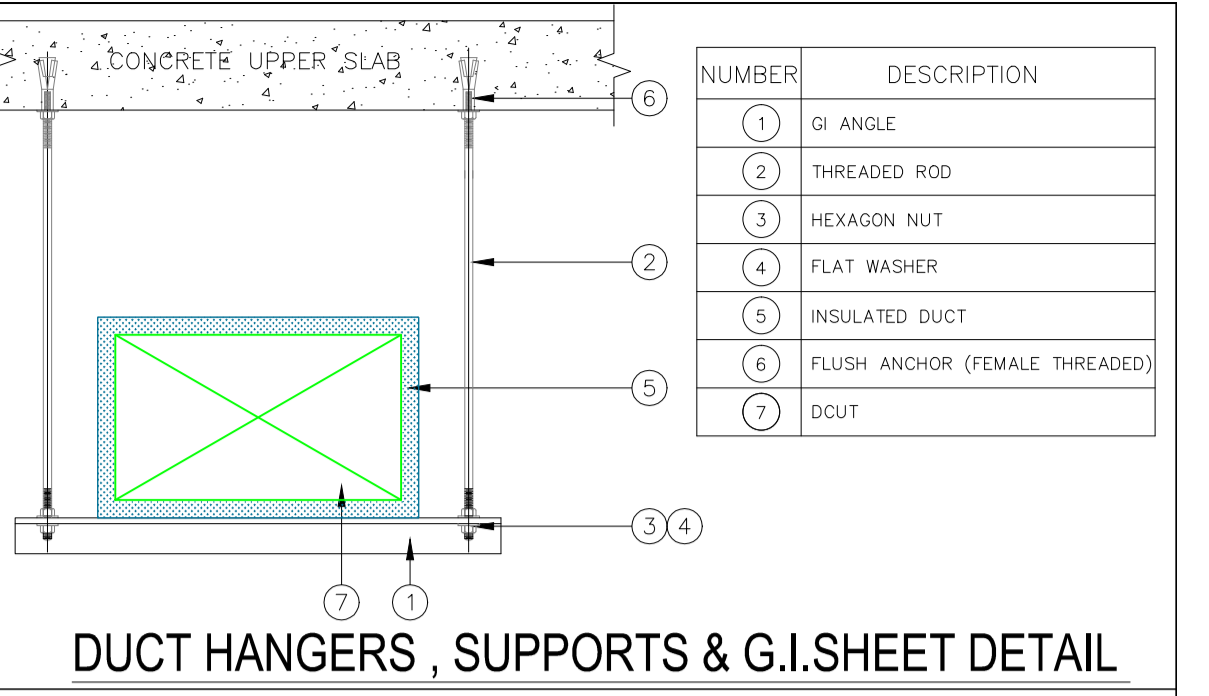

PRELIMINARY	<input checked="" type="checkbox"/>	APPROVED	<input type="checkbox"/>	SIGN	
				DATE	
R7	1.12.14	Revised as per architecture layout	Manisha		
R6	25.10.14	Revised as per architecture layout	Manisha		
R5	23.08.14	Revised as per architecture layout	Manisha		
R4	23.08.14	Revised as per architecture layout	Manisha		
R3	23.08.14	Revised as per architecture layout	Manisha		
R2	3.04.14	Revised as per architecture layout	Manisha		
R1	3.04.14	Revised as per architecture layout	Manisha		
REV	DATE	REMARKS	DRN	APRD	

PROJECT: PROPOSED HVAC WORK AT AIROLI AUDITORIUM NAVI MUMBAI

CLIENT: NMMC

ARCHITECT: THE FIRM

TITLE: HVAC DUCTING LAYOUT AT 2nd BASEMENT FLOOR

SAINI ENGINEERING & CONSULTANCY

DRN	MANISHA	SCALE	DWG NO	R0.
APRD	J.GUPTA	1:100	SEAC/HVAC/DWG-09	R7
DATE	11/12/2013	PAPER:A1		